


# **IMPORTANT NOTICE**

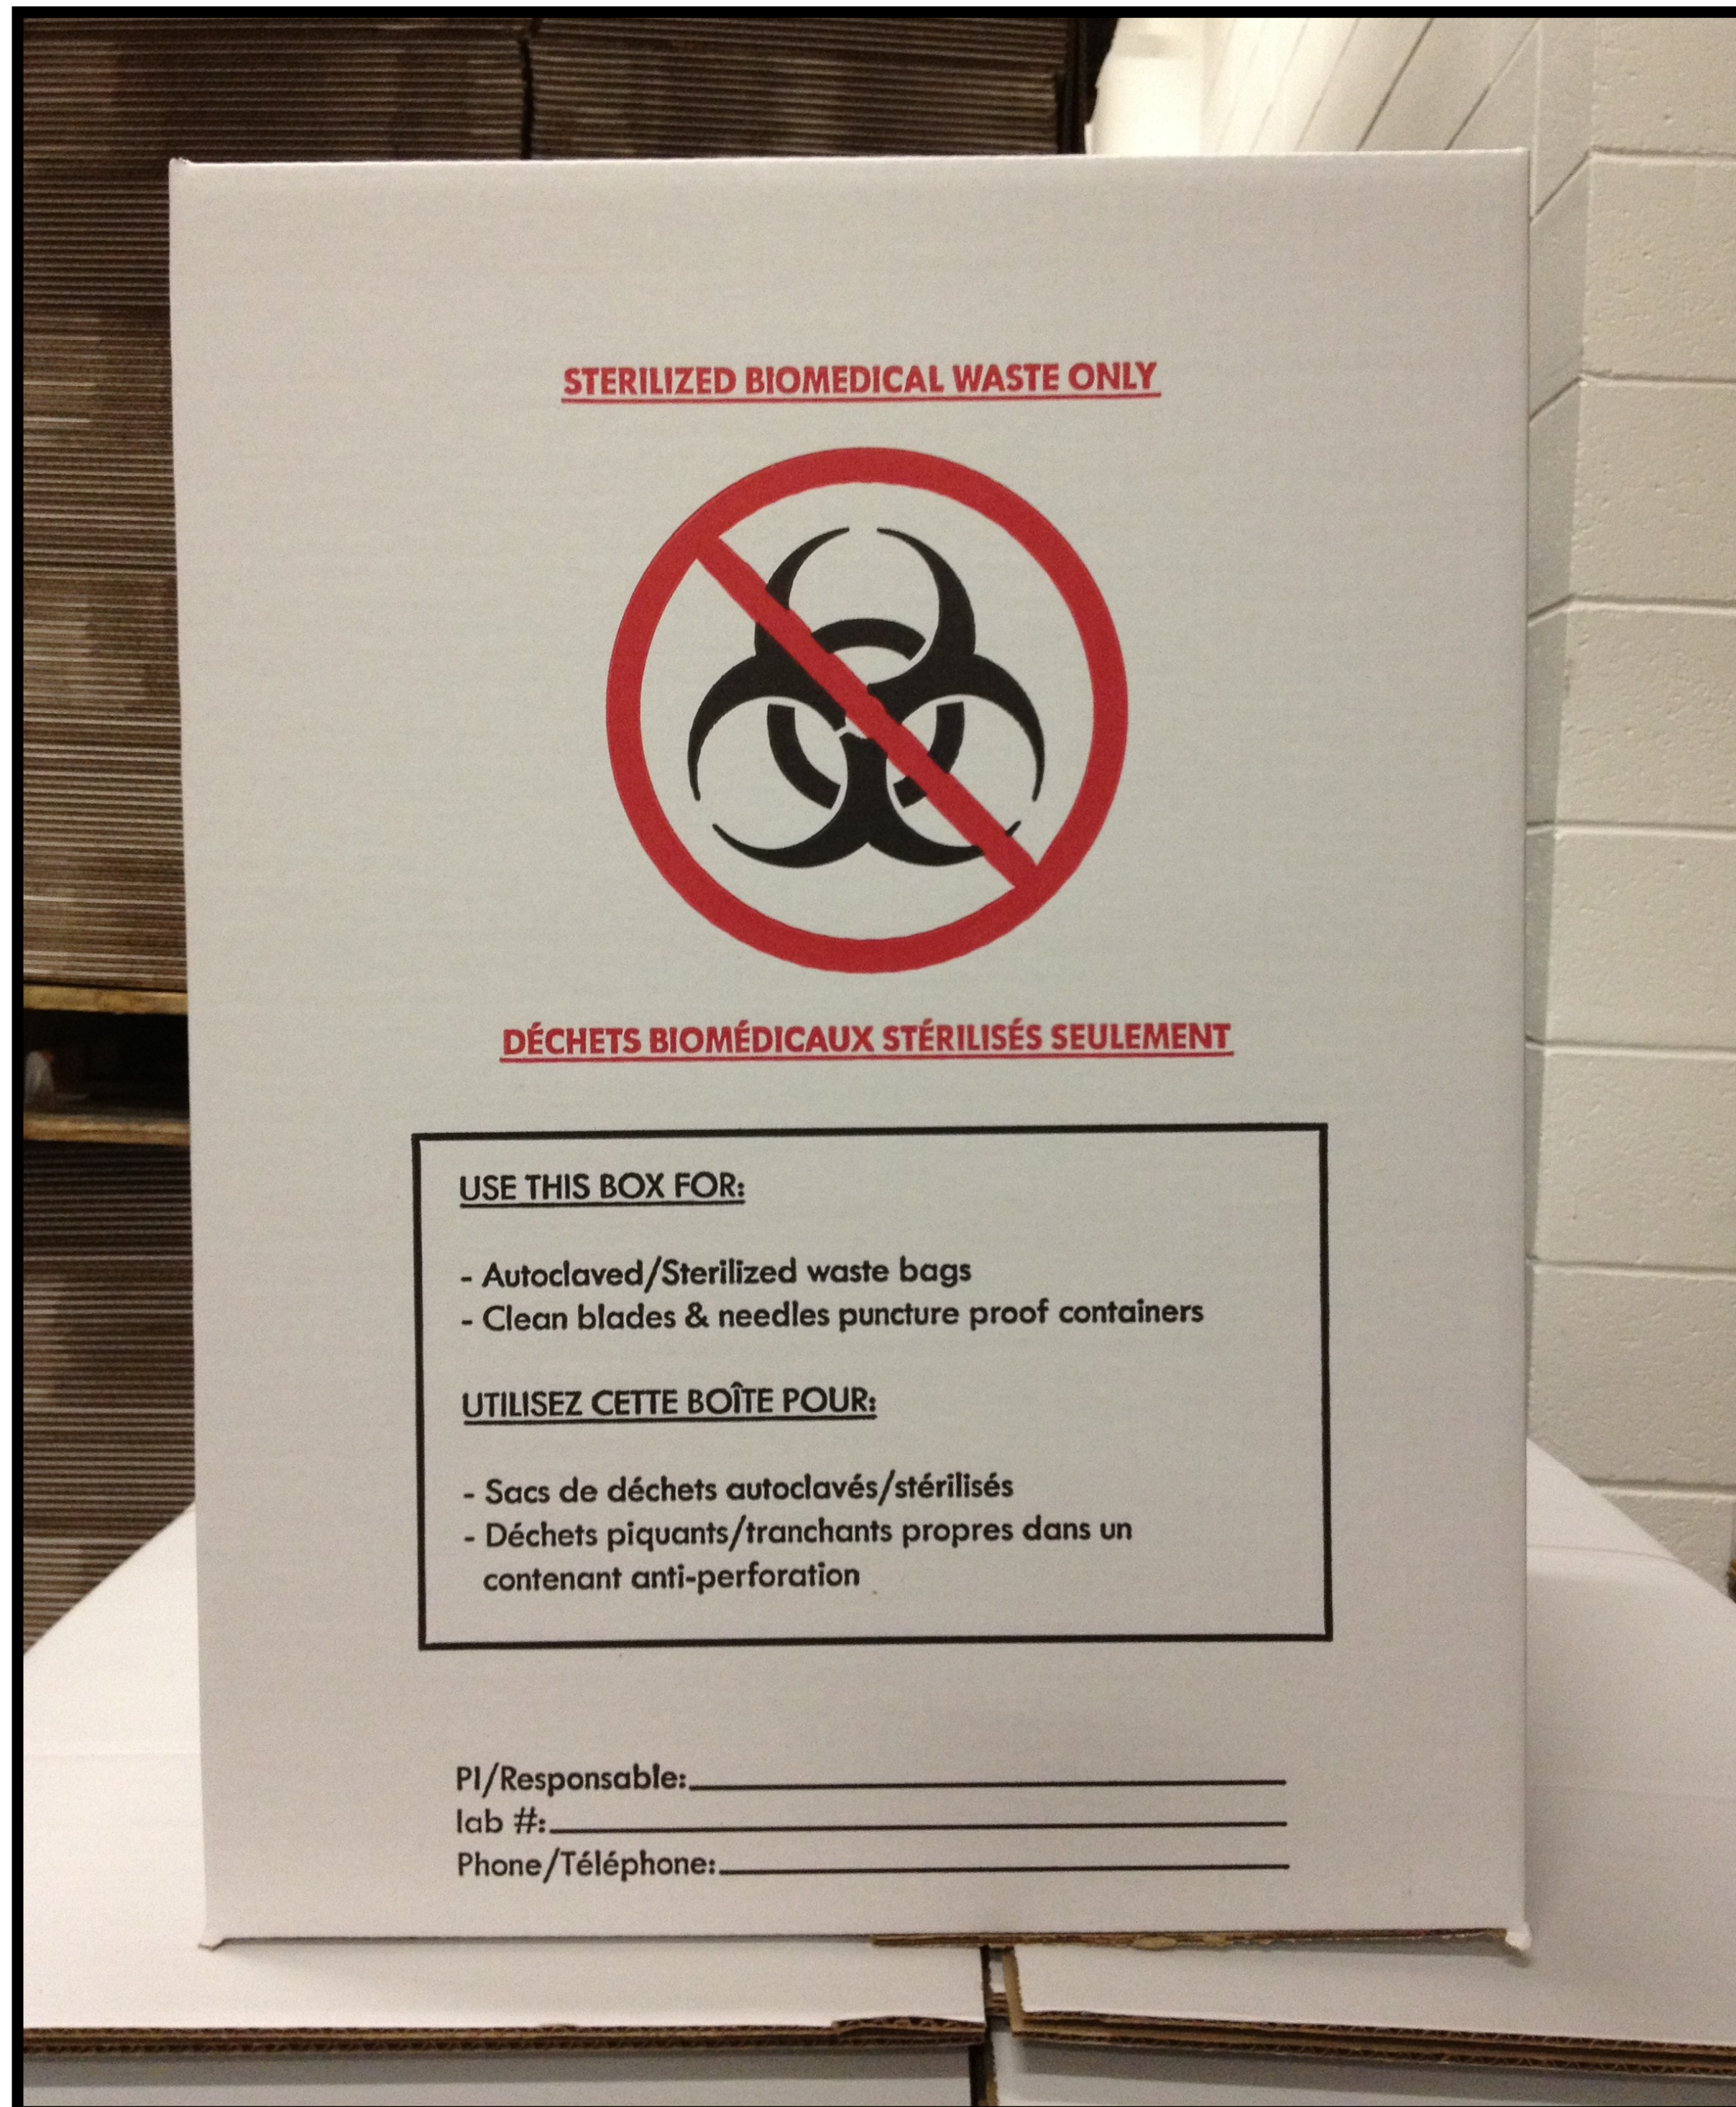

## **NEW CONTAINER IN CIRCULATION**

**Starting February 26th 2013, all autoclaved biomedical solid waste that used to go in the regular garbage MUST be disposed using the new white cardboard container. This box DOES NOT replace the biomedical waste box. It is meant to be used for biomedical waste that your laboratory already sterilized through autoclaving. When full, bring the box back to the waste room. Hazardous Waste Management will take care of proper disposal.**

**For more information go to [www.mcgill.ca/hwm](http://www.mcgill.ca/hwm)**

**DO NOT USE THIS BOX FOR BIOMEDICAL WASTE**